



Typical view of wall thermostat (dark screen)

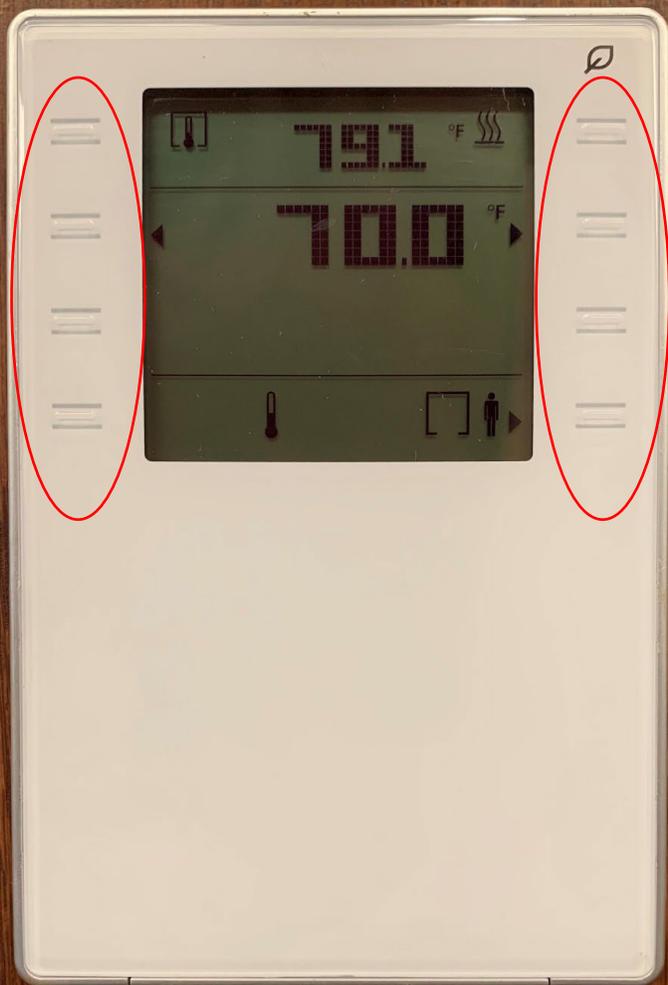


Pushing any button will "light up" the screen

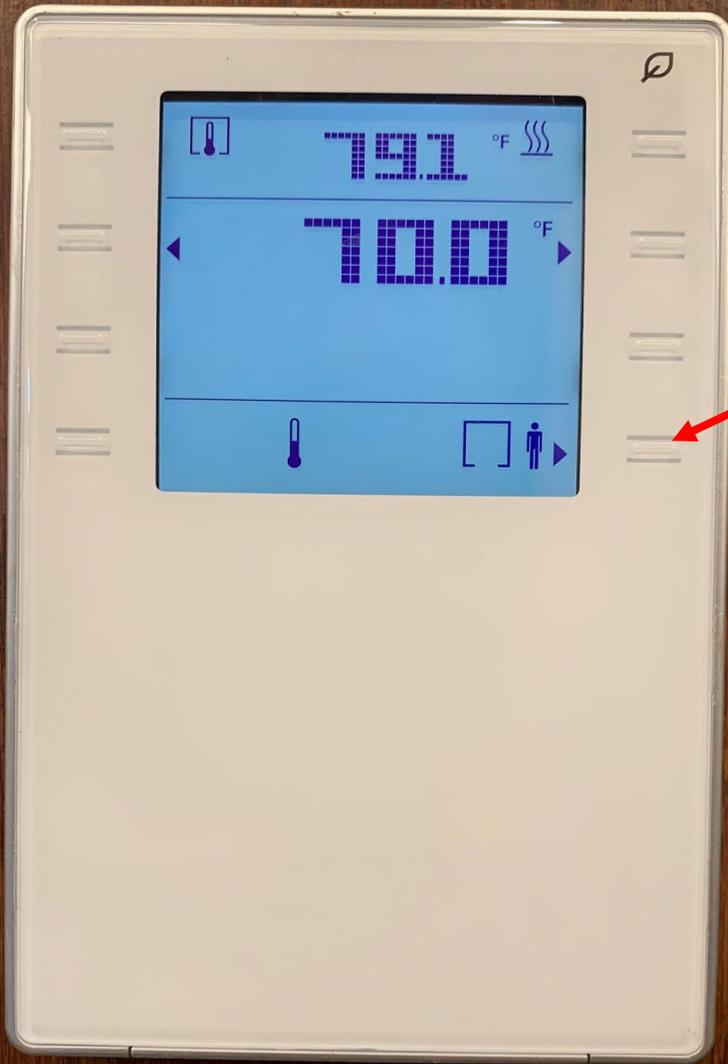

Now that the screen is “lit”, push this button for 4 hours of cooling


SIEMENS

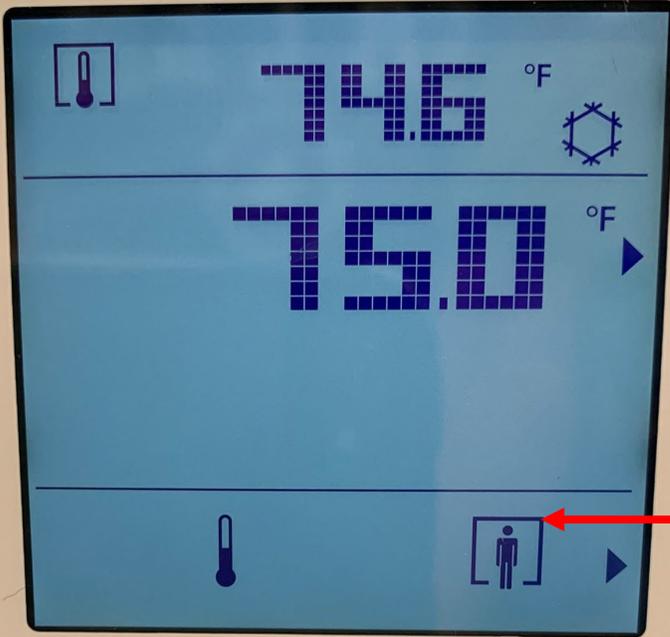

The person icon moved into the box indicating that the system has accepted the 4 hour call for cooling. After 4 hours, the room will stop cooling and the button will need to be pushed again.


75 is the cooling set point for all office groups. The next few slides describes how to adjust the cooling set point for all classrooms.

SIEMENS

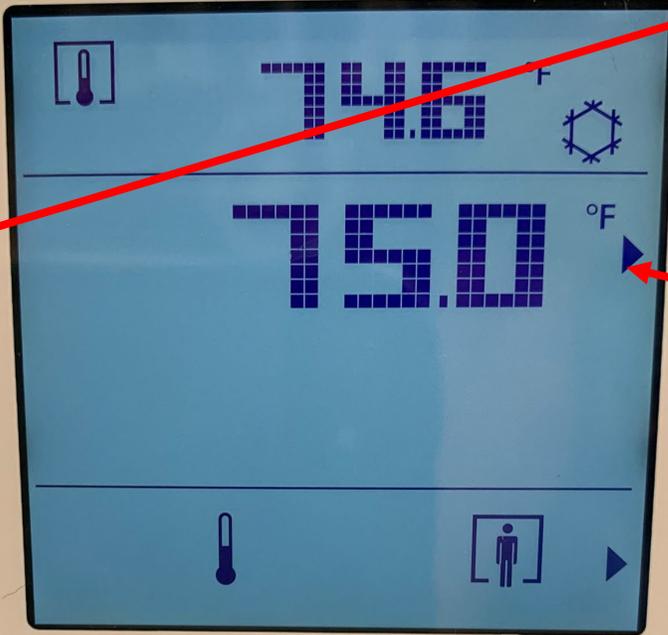

You can then adjust the room set point up or down by pushing these buttons.

75 is the lowest cooling set point. Notice that only the up arrow is present on the screen.

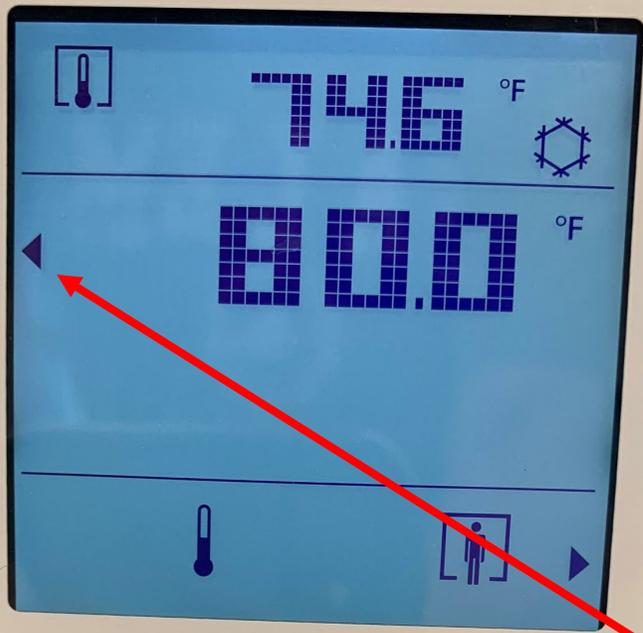

80 is the highest cooling set point. Notice that only the down arrow is present on the screen.